


LUMINAIRE PHOTOMETRIC TEST REPORT

Report number:


MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

DATA OF LAMP		Imax (cd)	11473	S/MH (C0/180)	0.35
MODEL	FLEXION 95	EFFICIENCY (%)	100.0	S/MH (C90/270)	0.30
NOMINAL POWER (W)	20	TOTAL FLUX (lm)	1770.4	Voltage (V)	219.6
RATED VOLTAGE (V)	220	EFFICIENCY (lm/W)	91.0	Current (A)	0.088
NOMINAL FLUX (lm)	1770.4	η up (%)	0.0	Power (W)	19.45
LAMPS QUANTITY	1	η down (%)	100.0	Power Factor (PF)	0.996
TEST VOLTAGE (V)	219.7	Effictive Flux(lm)	1474.0	EEI	0.180

LUMINOUS INTENSITY DISTRIBUTION

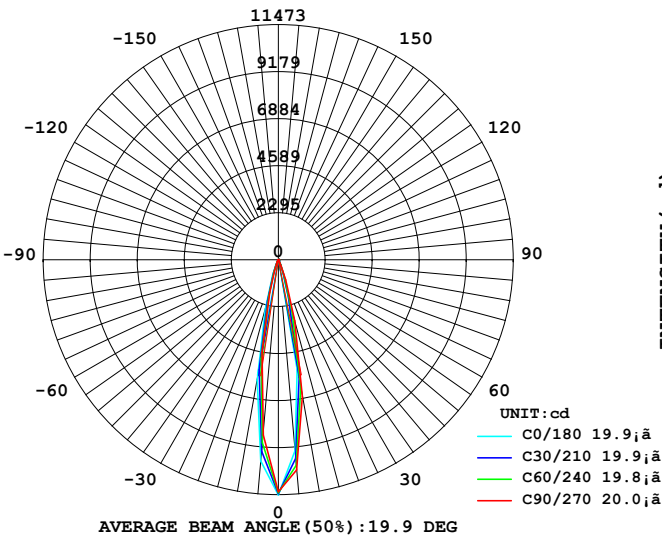

LUMINOUS INTENSITY DISTRIBUTION

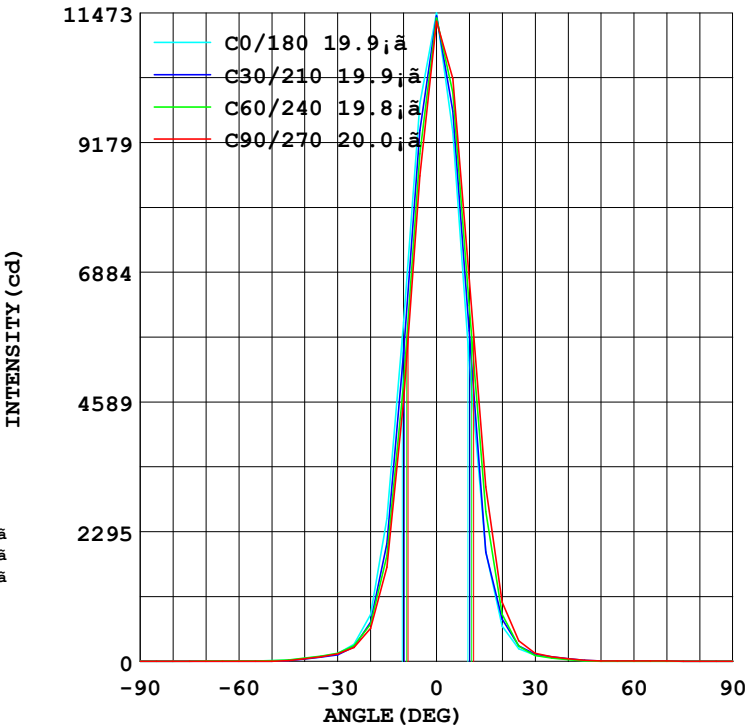

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K

Color Temperature Data List

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:


Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K

AVERAGE AND CENTER E Figure

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

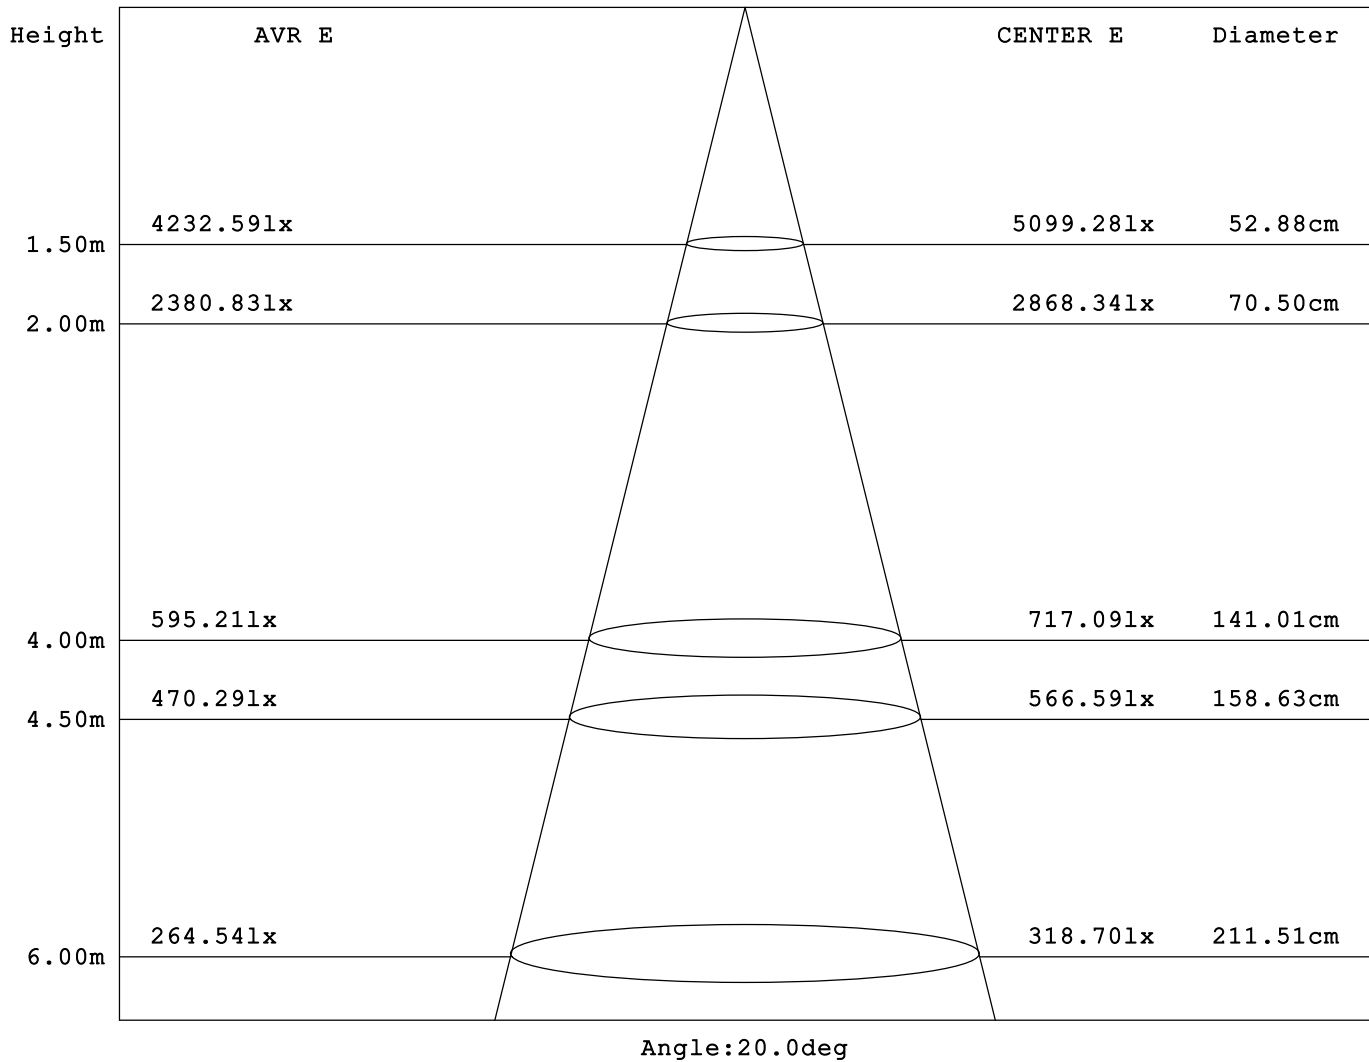

Test System: HOPOO HPG1800
 Temperature: 25.3DEG
 Operators:
 Test Date: 07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.500 m
 Remarks: 4000K

ZONAL FLUX DIAGRAM

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Zone	total
10.0	598.9	517.8	460.4	447.6	532.2	607.2	678.3	692.1	0- 10	792.5	792.5
20.0	83.05	67.60	58.58	56.63	62.82	79.50	105.2	108.1	10- 20	726.7	1519
30.0	14.00	13.26	13.35	13.11	10.83	11.76	14.43	14.45	20- 30	165.0	1684
40.0	5.303	5.144	4.790	4.981	3.966	3.970	4.558	4.410	30- 40	52.63	1737
50.0	1.148	0.751	0.354	0.744	0.390	0.676	1.090	0.686	40- 50	16.70	1754
60.0	0.773	0.452	0.159	0.441	0.260	0.437	0.737	0.441	50- 60	5.036	1759
70.0	0.621	0.379	0.152	0.368	0.275	0.365	0.592	0.376	60- 70	4.141	1763
80.0	0.527	0.340	0.173	0.332	0.303	0.325	0.499	0.329	70- 80	3.842	1767
90.0	0.470	0.354	0.246	0.343	0.433	0.318	0.419	0.318	80- 90	3.736	1770
100.0									90-100		
110.0									100-110		
120.0									110-120		
130.0									120-130		
140.0									130-140		
150.0									140-150		
160.0									150-160		
170.0									160-170		
180.0									170-180		
DEG	LUMINOUS INTENSITY: 1cd									UNIT:lm	

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K


LUMINANCE LIMITATION CURVES

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

LUMINANCE LIMITATION CURVES

GLARE	CLASS	ILLUMINANCE (lx)							
		2000	1000	500	<=300				
1.15	A								
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

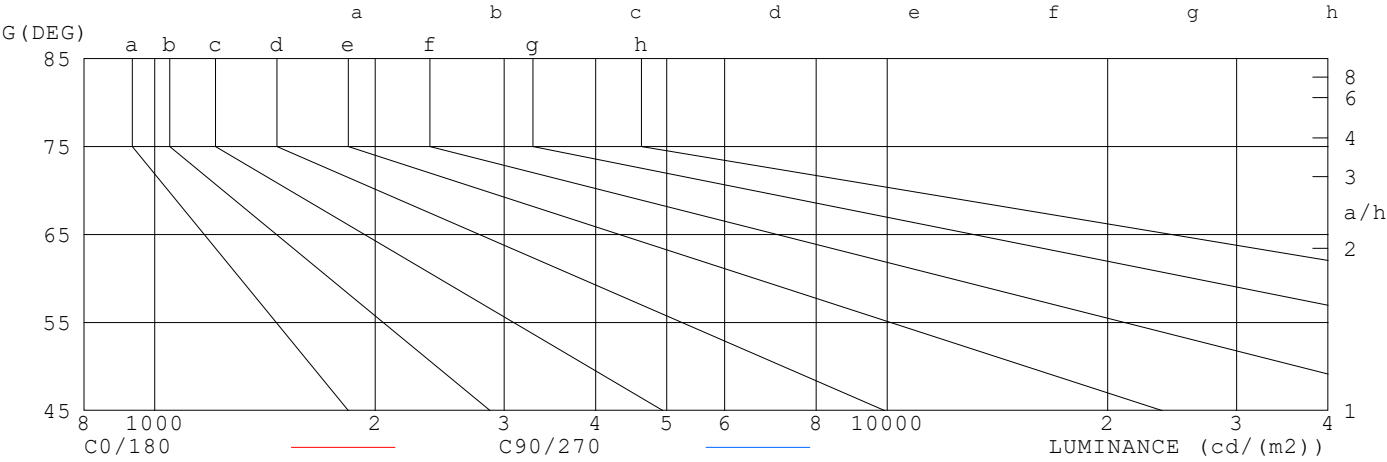

LUMINANCE cd/m2

G (DEG)	C0/180	C90/270
85	564	207
80	304	100
75	221	61
70	182	44
65	162	36
60	155	32
55	159	34
50	179	55
45	319	204

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025


Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

UNIT: cd

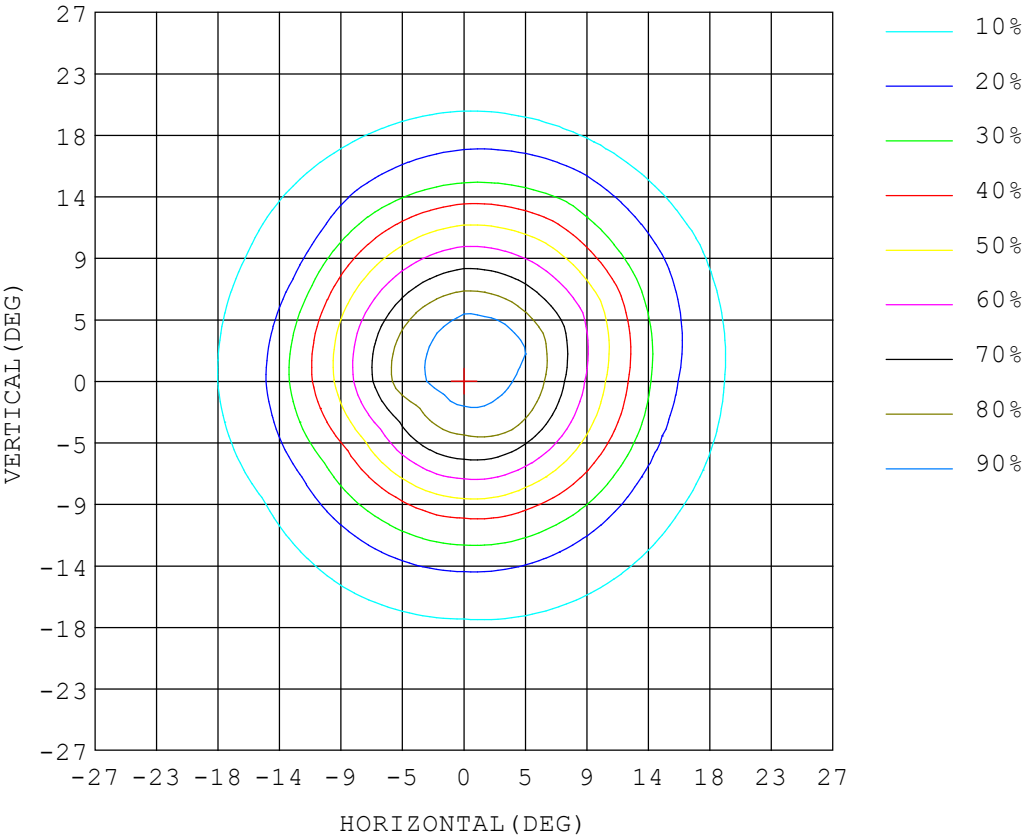


Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K

ISOLUX DIAGRAM

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

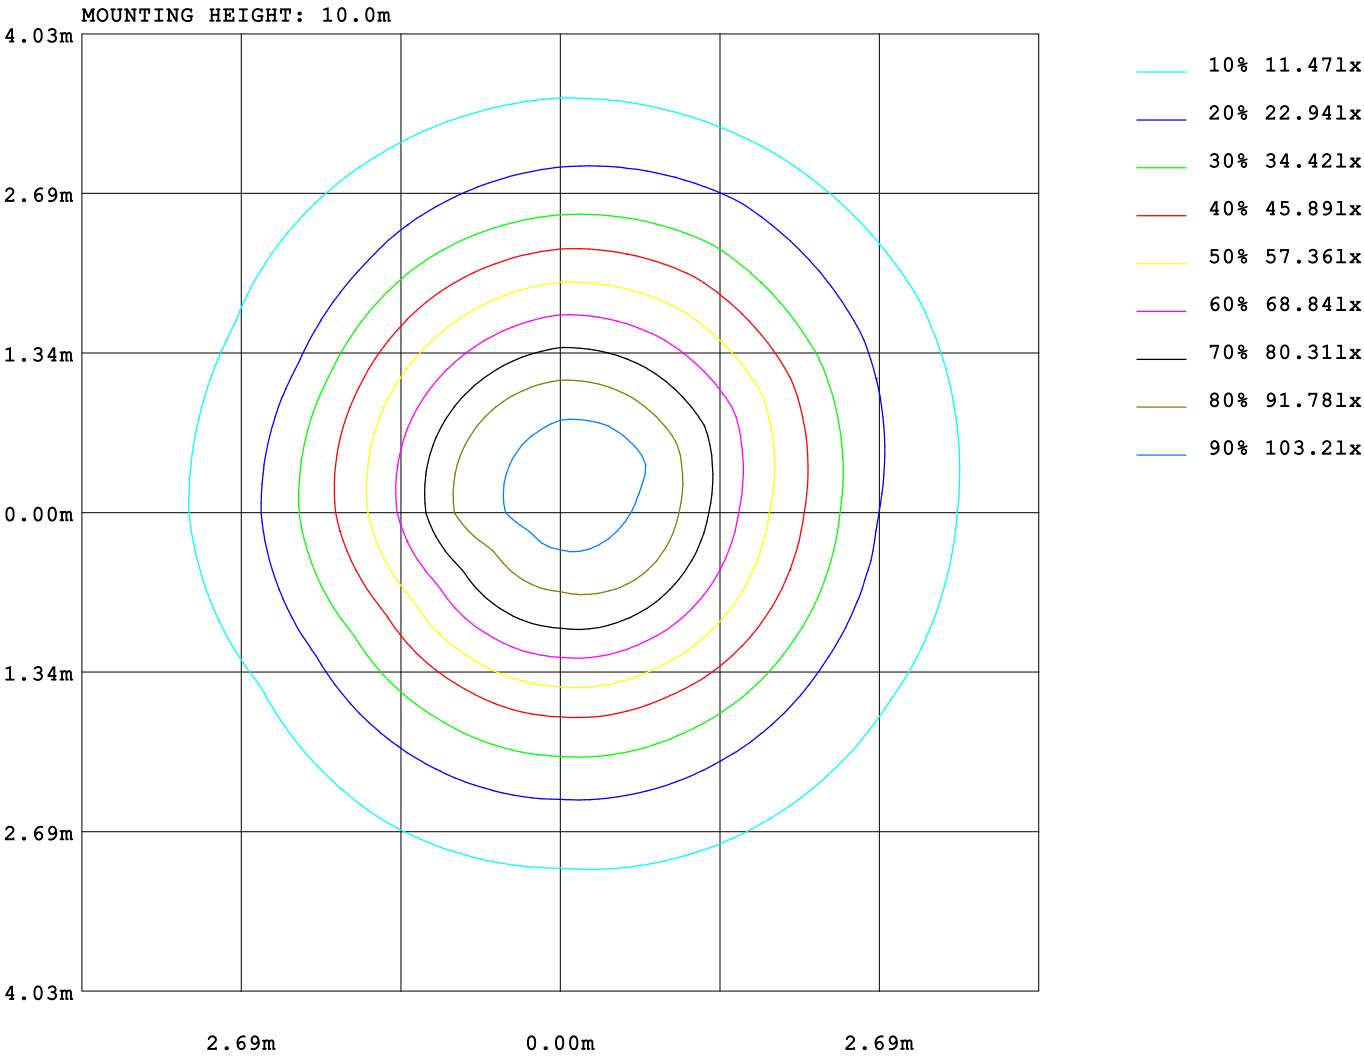

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K

AREA LUMINOUS FLUX

Report number:

MANUFACTURER: DIVINITY LIGHTS																				
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019																				
NAME: FLEXION 95										TYPE: 4000K CRI-90					WEIGHT:					
SPECIFICATION: FULHAM 500 MA										DIMENSION: D-106 CUTOUT-95 H-125 MM					SERIAL No.:					


27 24 21 18 15 12 9 <
--

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K

Report number:

pcc	80%			70%			50%			30%			10%			0														
p _w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
p _{fc}	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Coefficients of Utilization(CU)														
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00														
1.0	1.13	1.11	1.10	1.11	1.09	1.08	1.07	1.06	1.05	1.03	1.02	1.01	1.00	.99	.99	.97														
2.0	1.08	1.05	1.03	1.07	1.04	1.02	1.03	1.01	.00	1.01	.99	.98	.98	.97	.96	.94														
3.0	1.04	1.01	.98	1.03	.00	.97	1.00	.98	.96	.98	.96	.94	.96	.94	.93	.92														
4.0	1.00	.97	.94	.99	.96	.93	.97	.95	.92	.96	.93	.91	.94	.92	.90	.89														
5.0	.97	.93	.91	.96	.93	.90	.95	.92	.89	.93	.91	.89	.92	.90	.88	.87														
6.0	.94	.90	.88	.94	.90	.87	.92	.89	.87	.91	.88	.86	.90	.88	.86	.85														
7.0	.92	.88	.85	.91	.88	.85	.90	.87	.85	.89	.86	.84	.88	.86	.84	.83														
8.0	.89	.86	.83	.89	.85	.83	.88	.85	.83	.87	.84	.82	.86	.84	.82	.81														
9.0	.87	.83	.81	.87	.83	.81	.86	.83	.81	.85	.82	.80	.85	.82	.80	.79														
10.0	.85	.82	.79	.85	.81	.79	.84	.81	.79	.84	.81	.79	.83	.80	.79	.78														

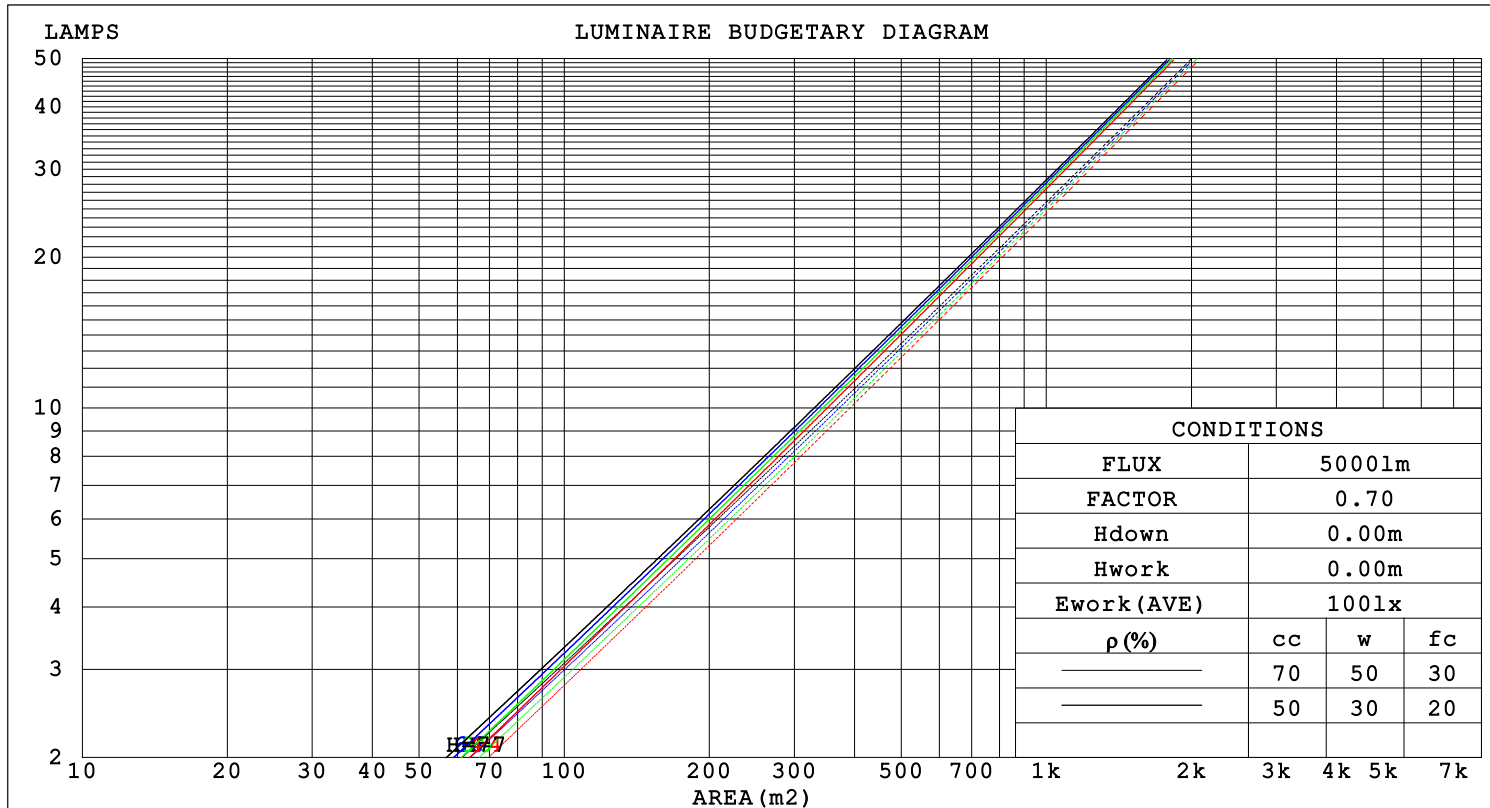

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K

WEC AND CCEC

Report number:

MANUFACTURER: DIVINITY LIGHTS														
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019														
NAME: FLEXION 95							TYPE: 4000K CRI-90					WEIGHT:		
SPECIFICATION: FULHAM 500 MA							DIMENSION: D-106 CUTOUT-95 H-125 MM					SERIAL No.:		

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.133	.075	.024	.126	.072	.023	.114	.065	.021	.102	.059	.019	.092	.053	.017	
2.0	.121	.066	.020	.116	.064	.020	.106	.059	.018	.096	.054	.017	.088	.050	.016	
3.0	.112	.060	.018	.107	.058	.017	.099	.054	.016	.091	.050	.015	.084	.047	.014	
4.0	.104	.054	.016	.100	.053	.016	.093	.049	.015	.087	.047	.014	.081	.044	.013	
5.0	.097	.050	.014	.094	.048	.014	.088	.046	.014	.083	.044	.013	.077	.041	.012	
6.0	.092	.046	.013	.089	.045	.013	.084	.043	.013	.079	.041	.012	.075	.039	.012	
7.0	.087	.043	.012	.084	.042	.012	.080	.040	.012	.076	.039	.011	.072	.037	.011	
8.0	.082	.040	.011	.080	.040	.011	.076	.038	.011	.073	.037	.011	.069	.036	.010	
9.0	.078	.038	.011	.077	.037	.010	.073	.036	.010	.070	.035	.010	.067	.034	.010	
10.0	.075	.036	.010	.073	.035	.010	.070	.034	.010	.067	.033	.010	.065	.033	.009	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.168	.158	.148	.144	.135	.128	.098	.093	.088	.057	.054	.051	.018	.017	.017	
2.0	.150	.133	.119	.128	.114	.103	.088	.079	.072	.051	.046	.042	.016	.015	.014	
3.0	.134	.113	.097	.115	.098	.084	.079	.068	.059	.046	.040	.035	.015	.013	.011	
4.0	.121	.098	.080	.104	.084	.069	.071	.059	.049	.041	.034	.029	.013	.011	.010	
5.0	.110	.085	.067	.095	.074	.058	.065	.052	.041	.038	.030	.024	.012	.010	.008	
6.0	.101	.075	.057	.087	.065	.049	.060	.046	.035	.035	.027	.021	.011	.009	.007	
7.0	.093	.067	.049	.080	.058	.042	.055	.041	.030	.032	.024	.018	.010	.008	.006	
8.0	.086	.060	.042	.074	.052	.037	.051	.037	.026	.030	.022	.015	.010	.007	.005	
9.0	.080	.054	.036	.069	.047	.032	.048	.033	.023	.028	.020	.013	.009	.006	.004	
10.0	.075	.049	.032	.065	.043	.028	.045	.030	.020	.026	.018	.012	.009	.006	.004	

Test System:HOPOO HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.500 m
 Remarks: 4000K

Uncorrected UGR Table

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	-3.2	-2.6	-3.0	-2.4	-2.3	-2.5	-1.9	-2.3	-1.7	-1.6
3H	-2.5	-2.0	-2.3	-1.8	-1.6	-2.3	-1.7	-2.1	-1.5	-1.4
4H	-1.9	-1.3	-1.6	-1.1	-0.9	-2.1	-1.6	-1.9	-1.4	-1.2
6H	-0.8	-0.3	-0.5	-0.1	0.2	-1.9	-1.3	-1.6	-1.1	-0.9
8H	-0.1	0.4	0.2	0.7	0.9	-1.7	-1.2	-1.4	-1.0	-0.7
12H	0.9	1.3	1.2	1.6	1.9	-1.4	-0.9	-1.1	-0.7	-0.4
4H 2H	-3.2	-2.7	-2.9	-2.5	-2.2	-2.5	-2.0	-2.2	-1.7	-1.5
3H	-2.5	-2.0	-2.2	-1.8	-1.5	-1.9	-1.4	-1.6	-1.2	-0.9
4H	-1.7	-1.3	-1.4	-1.0	-0.7	-1.4	-1.0	-1.1	-0.7	-0.4
6H	-0.4	-0.1	-0.1	0.3	0.6	-0.8	-0.4	-0.4	-0.1	0.3
8H	0.5	0.8	0.8	1.2	1.5	-0.5	-0.1	-0.1	0.2	0.6
12H	1.7	2.0	2.1	2.4	2.8	0.0	0.4	0.4	0.7	1.1
8H 4H	-1.5	-1.1	-1.1	-0.8	-0.4	-1.1	-0.8	-0.8	-0.4	-0.1
6H	-0.2	0.1	0.2	0.5	0.9	0.1	0.4	0.5	0.8	1.2
8H	0.8	1.1	1.2	1.5	1.9	0.8	1.0	1.2	1.5	1.9
12H	2.3	2.5	2.7	2.9	3.4	1.6	1.9	2.1	2.3	2.8
12H 4H	-1.4	-1.0	-1.0	-0.7	-0.3	-1.1	-0.8	-0.7	-0.4	-0.1
6H	0.0	0.3	0.5	0.7	1.1	0.2	0.5	0.6	0.9	1.3
8H	1.0	1.2	1.5	1.7	2.1	1.1	1.4	1.6	1.8	2.3

Variations with the observer position at spacings:

S = 1.0H	+ 1.3 / - 1.0	+ 1.1 / - 1.1
1.5H	+ 2.8 / - 1.2	+ 2.6 / - 1.3
2.0H	+ 1.6 / - 0.6	+ 0.6 / - 0.6

CIE Pub.117 Corrected 1770 lm Total Lamp Luminous Flux.(8log(F/F0) = 2.0)

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K

UTILIZATION FACTORS TABLE

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi, 301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	90	85	81	90	84	81	89	84	81	78
0.80	97	92	89	97	92	89	96	91	88	85
1.00	101	96	93	100	96	93	99	95	92	88
1.25	105	100	97	104	100	96	102	98	96	92
1.50	107	103	100	106	102	99	104	101	98	94
2.00	109	106	103	108	105	102	105	103	100	95
2.50	111	107	105	109	106	104	106	104	102	96
3.00	112	109	107	111	108	106	107	105	103	97
4.00	114	112	110	112	110	108	109	107	106	99
5.00	116	113	112	113	112	110	109	108	107	100
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		


Test System: HOPOO HPG1800
 Temperature: 25.3 DEG
 Operators:
 Test Date: 07-17-2025

Test Set: 5.0 deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.500 m
 Remarks: 4000K

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

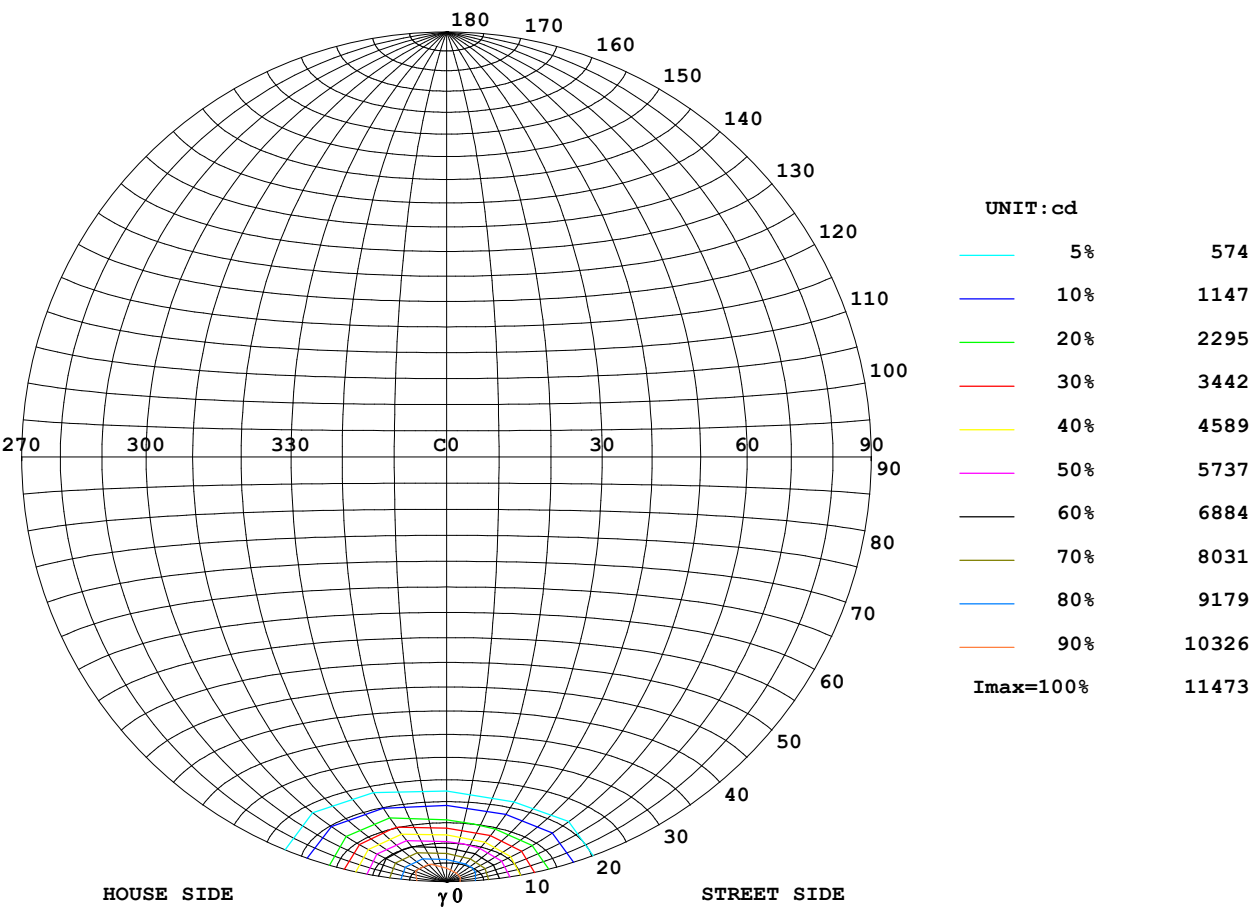

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025



Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K

ISOLUX DIAGRAM

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

ILLUMINANCE AT MH=10 m,Enadir = 114.73 lx

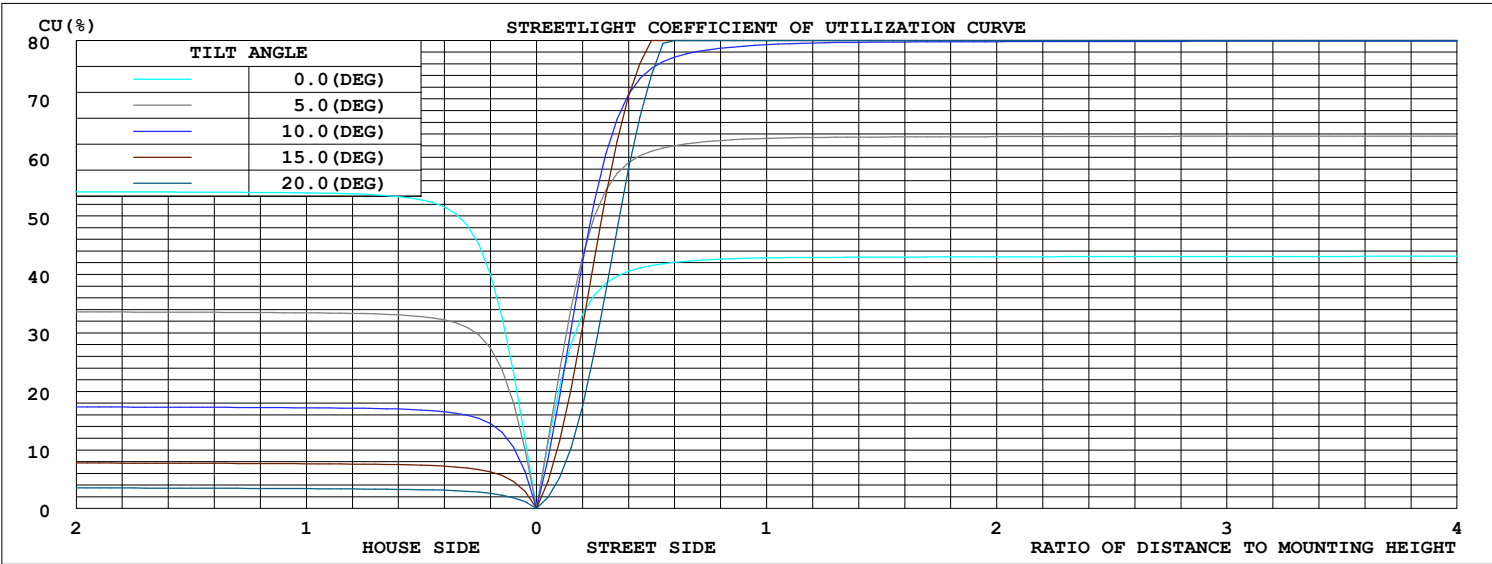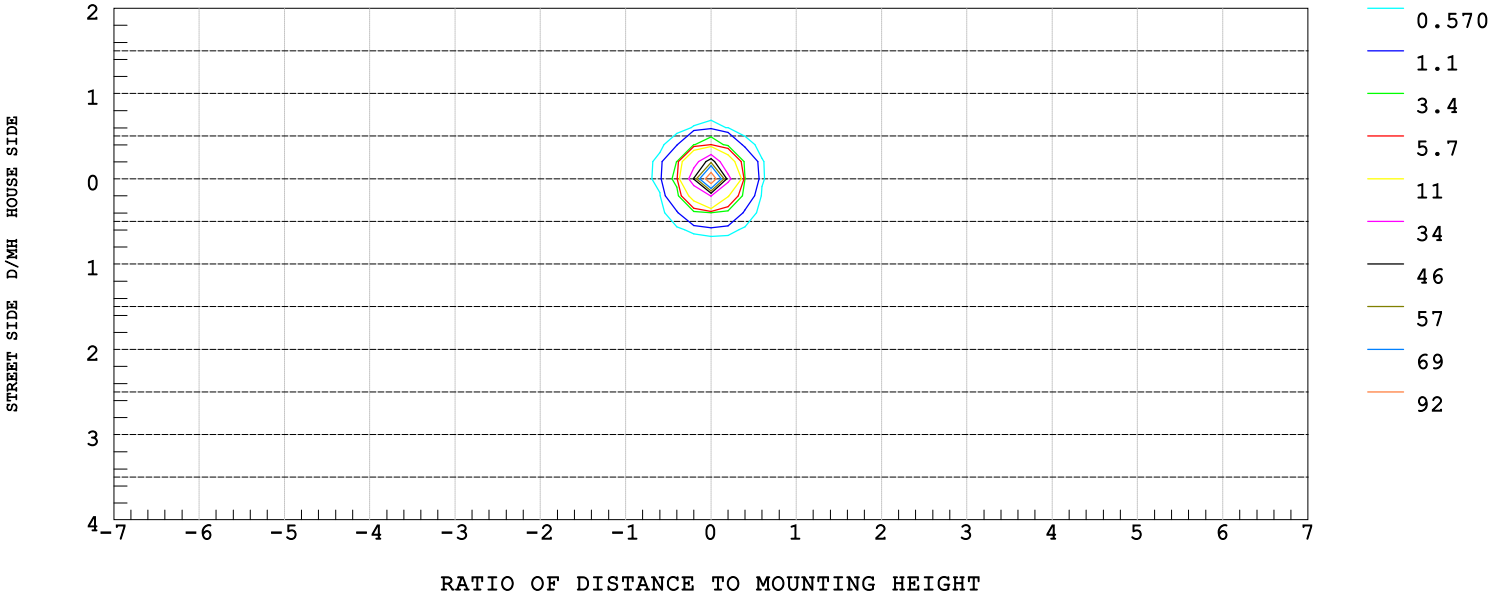


Test System:HOP00 HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

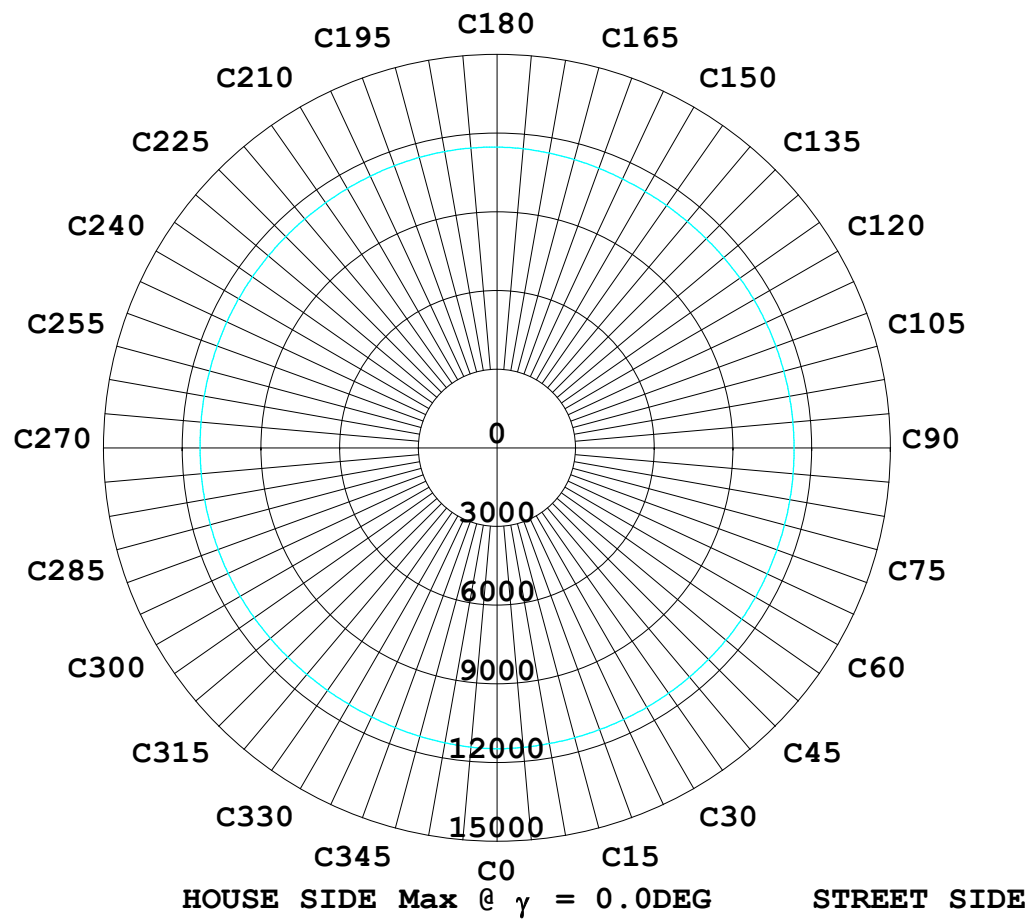

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K

LUMINOUS DISTRIBUTION INTENSITY DATA

Report number:

MANUFACTURER: DIVINITY LIGHTS		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: FLEXION 95	TYPE: 4000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM 500 MA	DIMENSION: D-106 CUTOUT-95 H-125 MM	SERIAL No.:

UNIT: ;Å10cd

C (DEG)												
γ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330
0.0	1147	1142	1138	1132	1131	1129	1147	1142	1138	1132	1131	1129
5.0	987	939	898	859	851	849	937	973	1006	1031	1041	1042
10.0	599	545	490	460	445	450	532	585	630	678	692	692
15.0	253	209	187	167	165	156	194	193	265	309	349	319
20.0	83.0	69.1	66.1	58.5	60.7	52.5	62.8	75.2	83.7	105	107	109
25.0	30.3	25.9	28.0	24.7	27.3	21.4	22.5	27.5	27.0	36.3	36.9	37.8
30.0	14.0	11.8	14.6	13.3	15.2	11.0	10.8	12.8	10.6	14.4	13.4	15.4
35.0	8.99	7.57	9.59	8.25	9.93	7.44	7.33	8.25	6.19	8.13	6.92	8.89
40.0	5.30	4.32	5.96	4.79	5.94	4.01	3.96	4.75	3.18	4.55	3.46	5.36
45.0	2.25	1.24	2.47	1.44	2.42	1.07	1.21	2.08	0.97	2.03	1.04	2.34
50.0	1.14	0.31	1.19	0.35	1.19	0.30	0.39	1.10	0.25	1.09	0.24	1.13
55.0	0.91	0.20	0.90	0.20	0.88	0.17	0.27	0.85	0.16	0.86	0.16	0.88
60.0	0.77	0.16	0.74	0.16	0.74	0.14	0.26	0.73	0.14	0.74	0.14	0.74
65.0	0.69	0.16	0.66	0.15	0.65	0.14	0.27	0.65	0.14	0.66	0.14	0.66
70.0	0.62	0.17	0.59	0.15	0.59	0.15	0.27	0.58	0.15	0.59	0.15	0.60
75.0	0.57	0.17	0.53	0.16	0.53	0.15	0.29	0.53	0.16	0.53	0.15	0.54
80.0	0.53	0.18	0.50	0.17	0.50	0.17	0.30	0.49	0.16	0.50	0.16	0.50
85.0	0.49	0.20	0.47	0.18	0.47	0.18	0.32	0.46	0.17	0.46	0.17	0.46
90.0	0.47	0.26	0.45	0.25	0.44	0.25	0.43	0.42	0.22	0.42	0.22	0.42

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:07-17-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.500 m
Remarks: 4000K