


LUMINAIRE PHOTOMETRIC TEST REPORT

Report number:


MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:

DATA OF LAMP		Imax (cd)	3165	S/MH (C0/180)	0.87
MODEL	XTREME DUO PEGGY	EFFICIENCY (%)	100.0	S/MH (C90/270)	0.81
NOMINAL POWER (W)	35	TOTAL FLUX (lm)	3790.8	Voltage (V)	219.3
RATED VOLTAGE (V)	220	EFFICIENCY (lm/W)	108.0	Current (A)	0.168
NOMINAL FLUX (lm)	3790.9	η up (%)	0.0	Power (W)	35.09
LAMPS QUANTITY	1	η down (%)	100.0	Power Factor (PF)	0.989
TEST VOLTAGE (V)	219.4	Effictive Flux (lm)	3444.4	EEI	0.139

LUMINOUS INTENSITY DISTRIBUTION

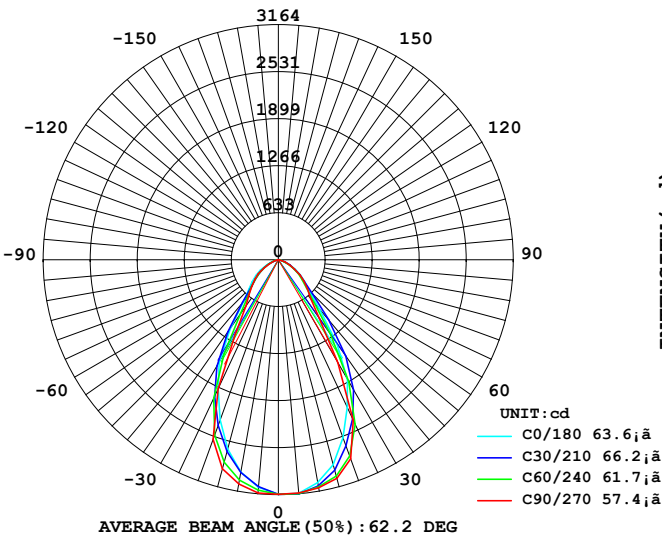

LUMINOUS INTENSITY DISTRIBUTION

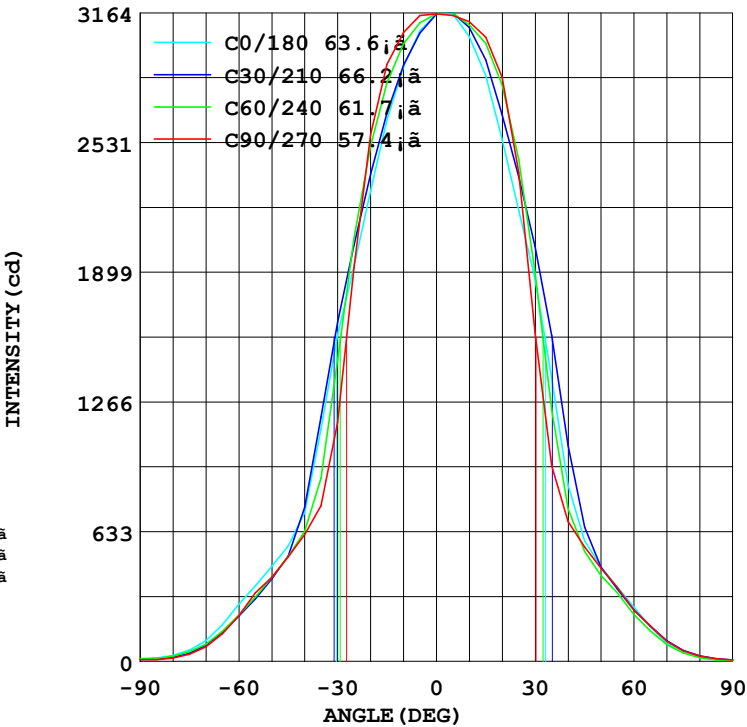

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

Color Temperature Data List

Report number:

MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:


Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

AVERAGE AND CENTER E Figure

Report number:

MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:

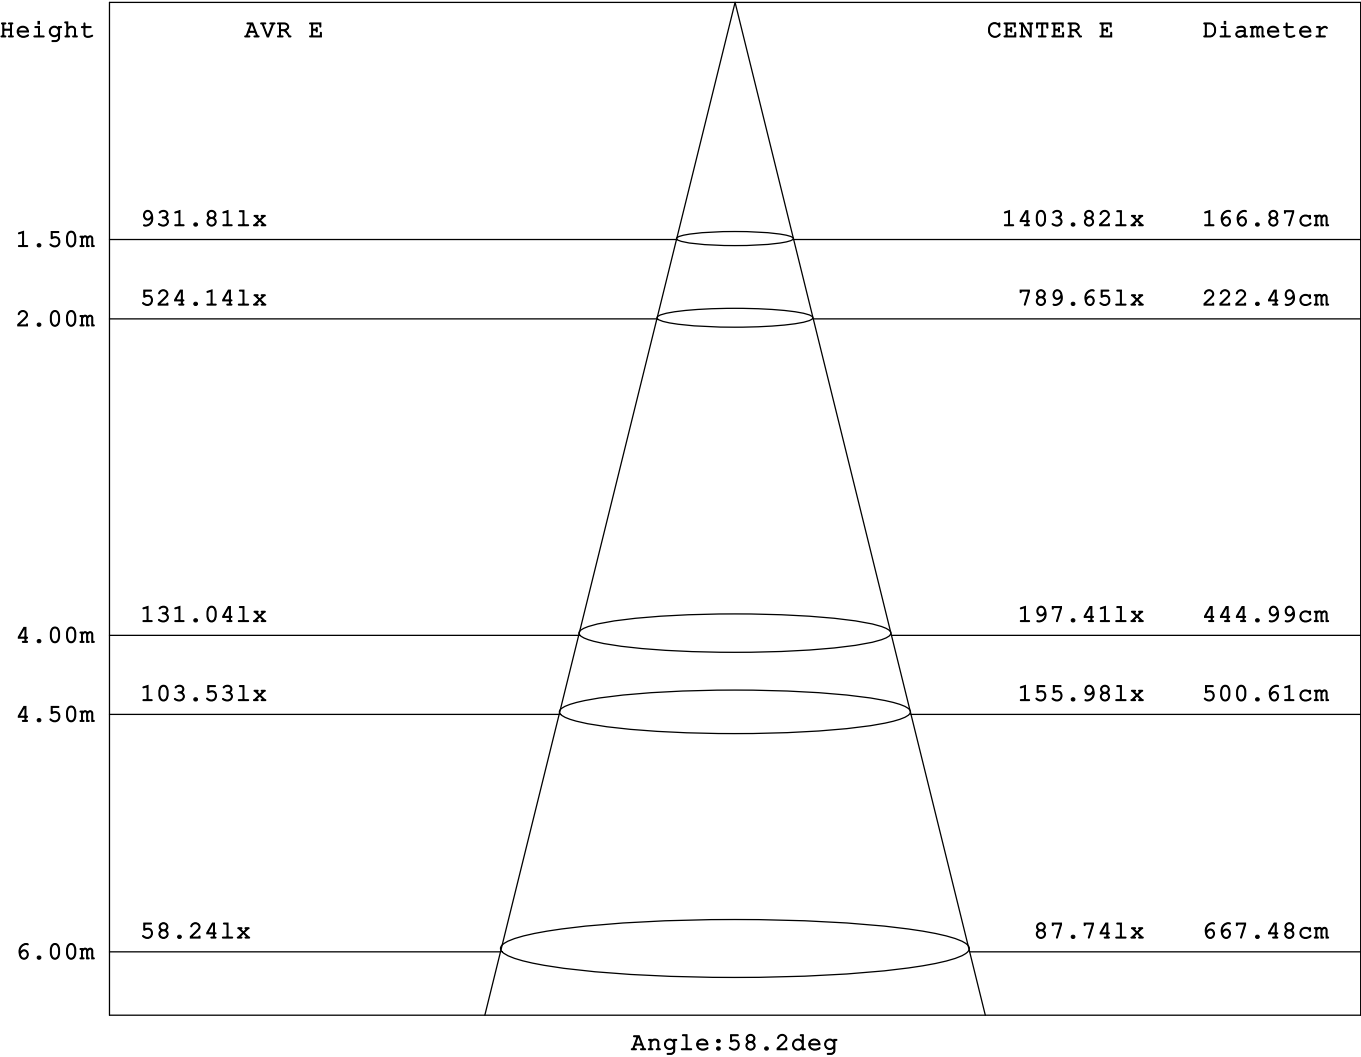

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

ZONAL FLUX DIAGRAM

Report number:

MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Zone	total
10.0	2903	2961	3068	3084	3049	3100	3121	2997	0- 10	295.8	295.8
20.0	2295	2445	2571	2630	2548	2740	2850	2548	10- 20	798.3	1094
30.0	1594	1563	1167	1707	1864	1961	1603	1771	20- 30	989.0	2083
40.0	725.9	692.9	619.1	753.2	861.5	899.7	682.9	788.0	30- 40	740.2	2823
50.0	462.5	405.6	410.2	413.1	461.1	439.9	455.1	427.8	40- 50	441.6	3265
60.0	278.5	222.8	222.1	224.2	264.2	239.6	250.0	238.4	50- 60	299.8	3565
70.0	99.95	81.16	71.36	80.87	89.91	91.32	97.92	90.63	60- 70	157.9	3723
80.0	28.75	22.84	16.36	22.27	20.08	23.28	26.16	23.12	70- 80	53.29	3776
90.0	12.87	11.29	8.181	9.922	6.885	5.467	7.290	5.305	80- 90	14.59	3791
100.0									90-100		
110.0									100-110		
120.0									110-120		
130.0									120-130		
140.0									130-140		
150.0									140-150		
160.0									150-160		
170.0									160-170		
180.0									170-180		
DEG	LUMINOUS INTENSITY:cd									UNIT:lm	

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025


Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

LUMINANCE LIMITATION CURVES

Report number:

MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:

LUMINANCE LIMITATION CURVES

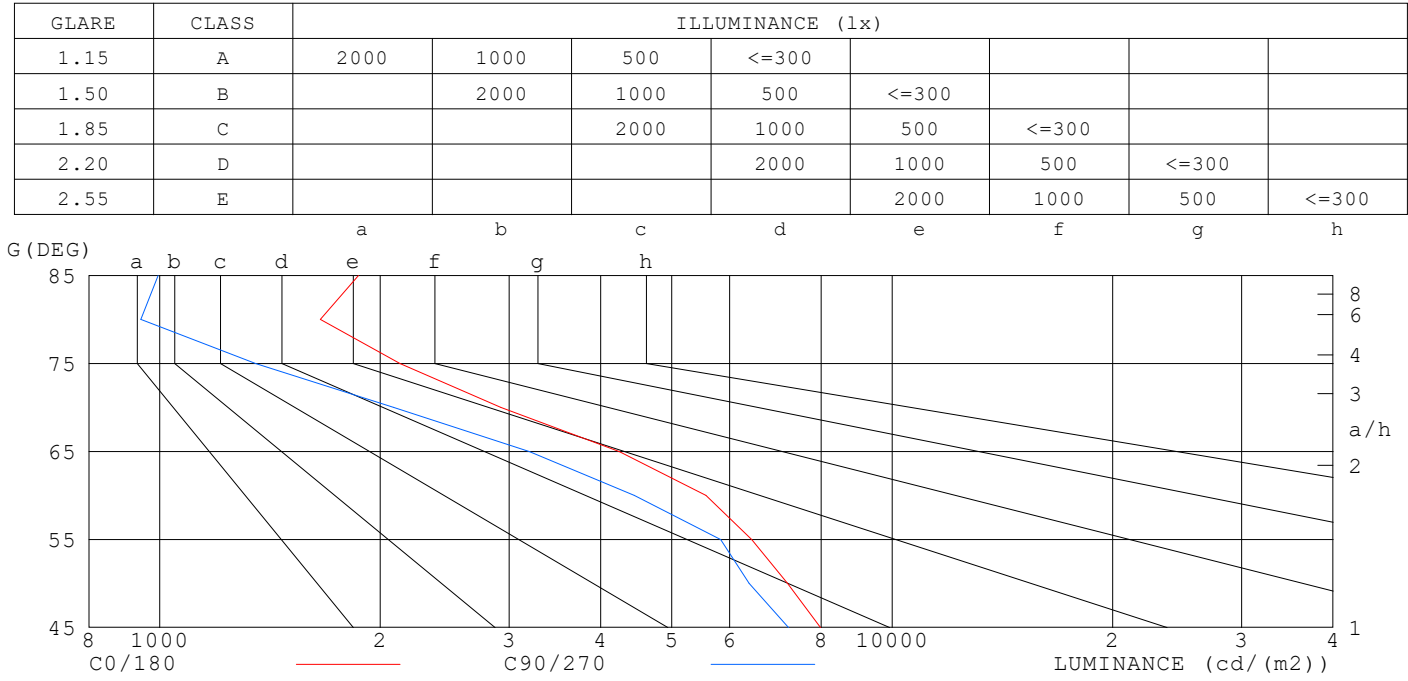

LUMINANCE cd/m2

G (DEG)	C0/180	C90/270
85	1868	994
80	1656	942
75	2128	1352
70	2922	2086
65	4240	3197
60	5571	4444
55	6431	5832
50	7197	6383
45	7982	7224


Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:

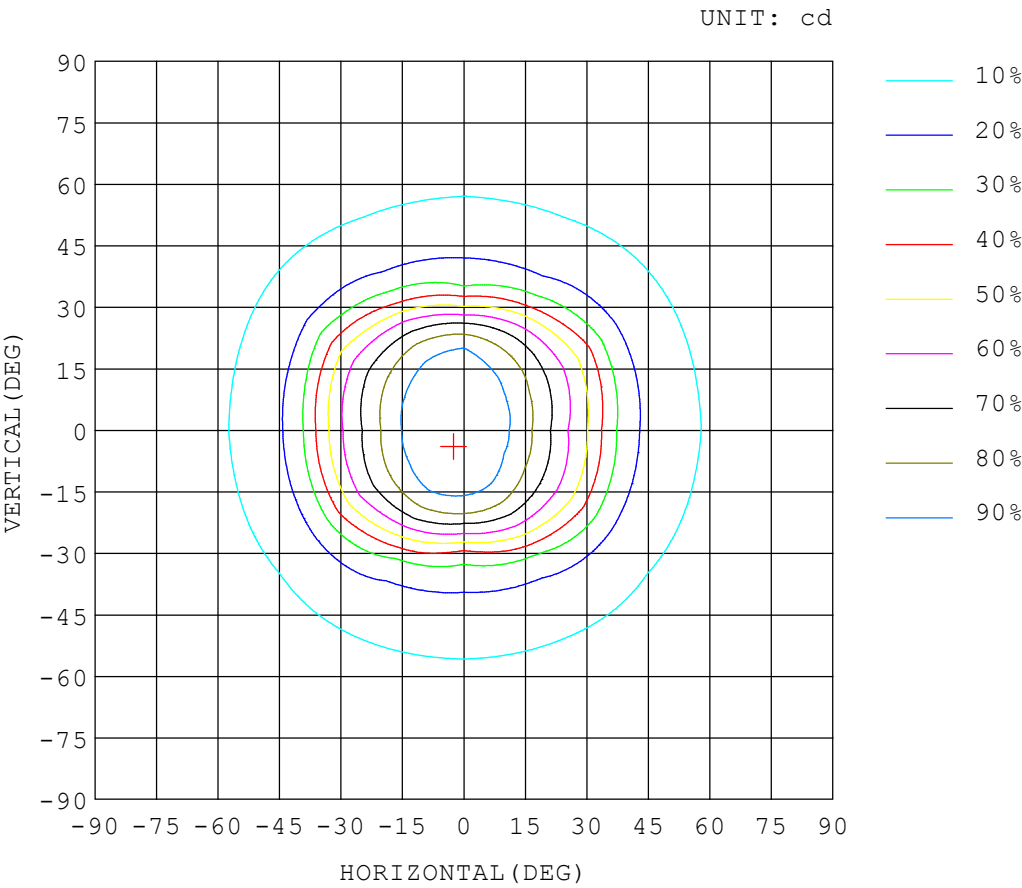


Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

ISOLUX DIAGRAM

Report number:

MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:

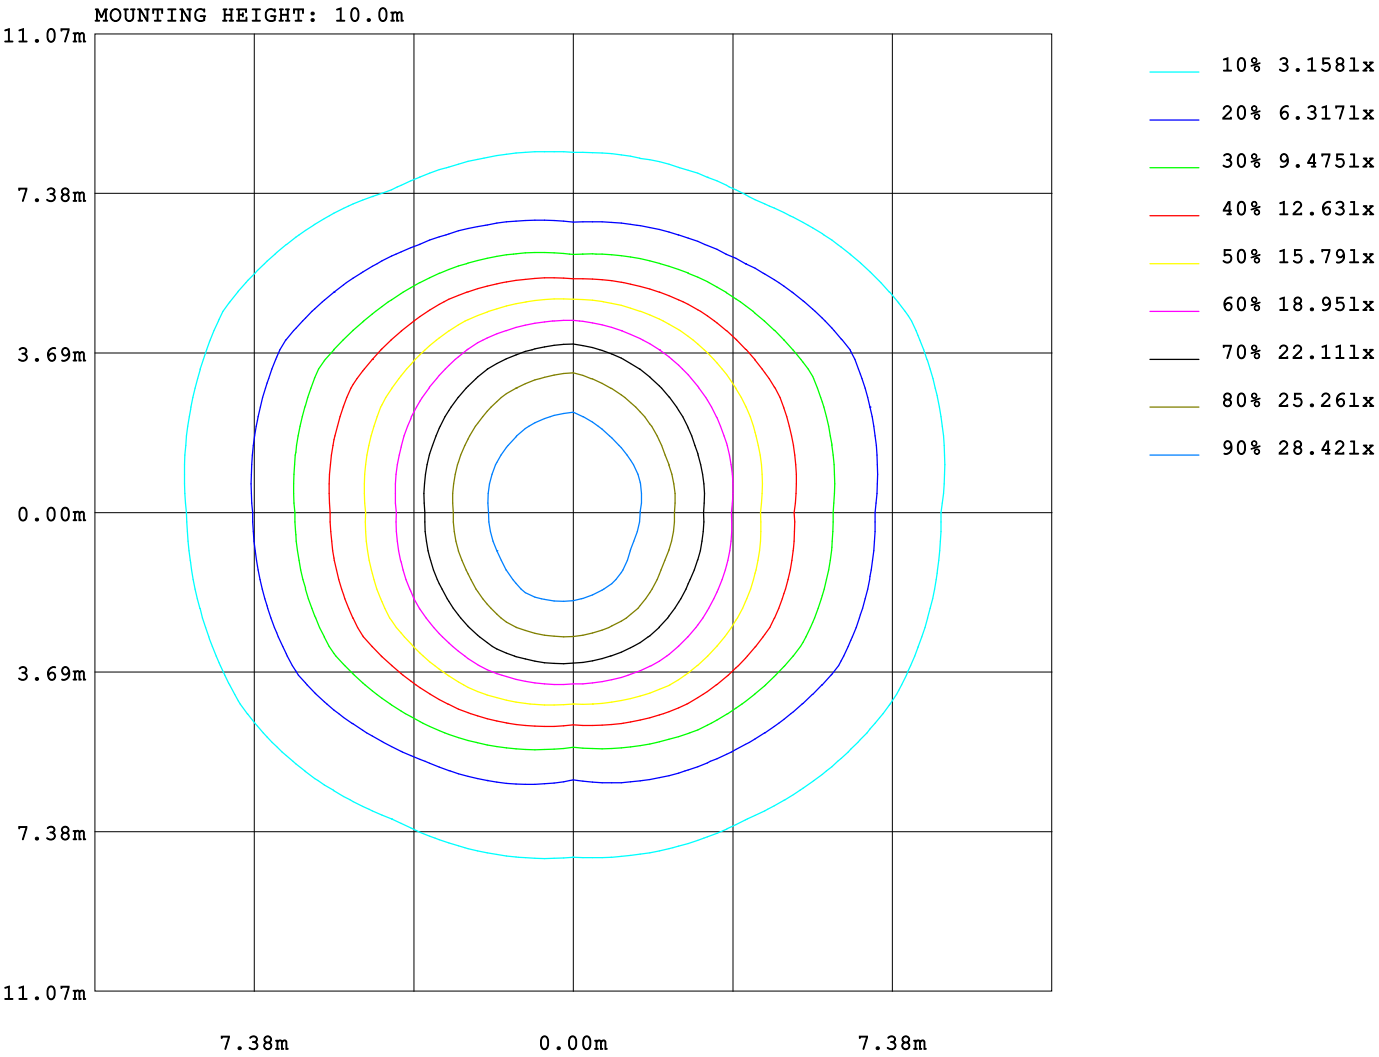

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

AREA LUMINOUS FLUX

Report number:

MANUFACTURER: DIVINITY																				
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019																				
NAME: XTREME DUO PEGGY ANTIGLARE										TYPE: 3000K CRI-90					WEIGHT:					
SPECIFICATION: FULHAM-800 MA										DIMENSION: 1200*190*27 MM					SERIAL No.:					

VERTICAL (DEG)	AREA FLUX DIAGRAM																		UNIT:lm		Φ t	Φ a
	0.02	0.06	0.12	0.18	0.20	0.20	0.24	0.33	0.41	0.41	0.33	0.23	0.20	0.19	0.17	0.14	0.09	0.03	3.56	0.00		
90																						
80																						
70																						
60																						
50																						
40																						
30																						

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025


Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Report number:

MANUFACTURER: DIVINITY															
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019															
NAME: XTREME DUO PEGGY ANTIGLARE								TYPE: 3000K CRI-90				WEIGHT:			
SPECIFICATION: FULHAM-800 MA								DIMENSION: 1200*190*27 MM				SERIAL No.:			

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pf _c	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Coefficients of Utilization(CU)															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.09	1.06	1.03	1.07	1.04	1.01	1.02	1.00	.98	.99	.97	.95	.95	.94	.92	.91
2.0	.99	.94	.90	.97	.93	.89	.94	.90	.87	.91	.88	.85	.88	.85	.83	.81
3.0	.91	.84	.80	.89	.84	.79	.86	.82	.78	.84	.80	.76	.81	.78	.75	.73
4.0	.83	.76	.71	.82	.76	.71	.80	.74	.70	.78	.73	.69	.76	.72	.68	.67
5.0	.77	.70	.65	.76	.69	.64	.74	.68	.64	.72	.67	.63	.70	.66	.62	.61
6.0	.71	.64	.59	.70	.63	.59	.68	.63	.58	.67	.62	.58	.66	.61	.57	.56
7.0	.66	.59	.54	.65	.59	.54	.64	.58	.53	.63	.57	.53	.61	.57	.53	.51
8.0	.61	.55	.50	.61	.54	.50	.60	.54	.49	.59	.53	.49	.58	.53	.49	.47
9.0	.58	.51	.46	.57	.51	.46	.56	.50	.46	.55	.50	.46	.54	.49	.46	.44
10.0	.54	.47	.43	.54	.47	.43	.53	.47	.43	.52	.46	.43	.51	.46	.43	.41

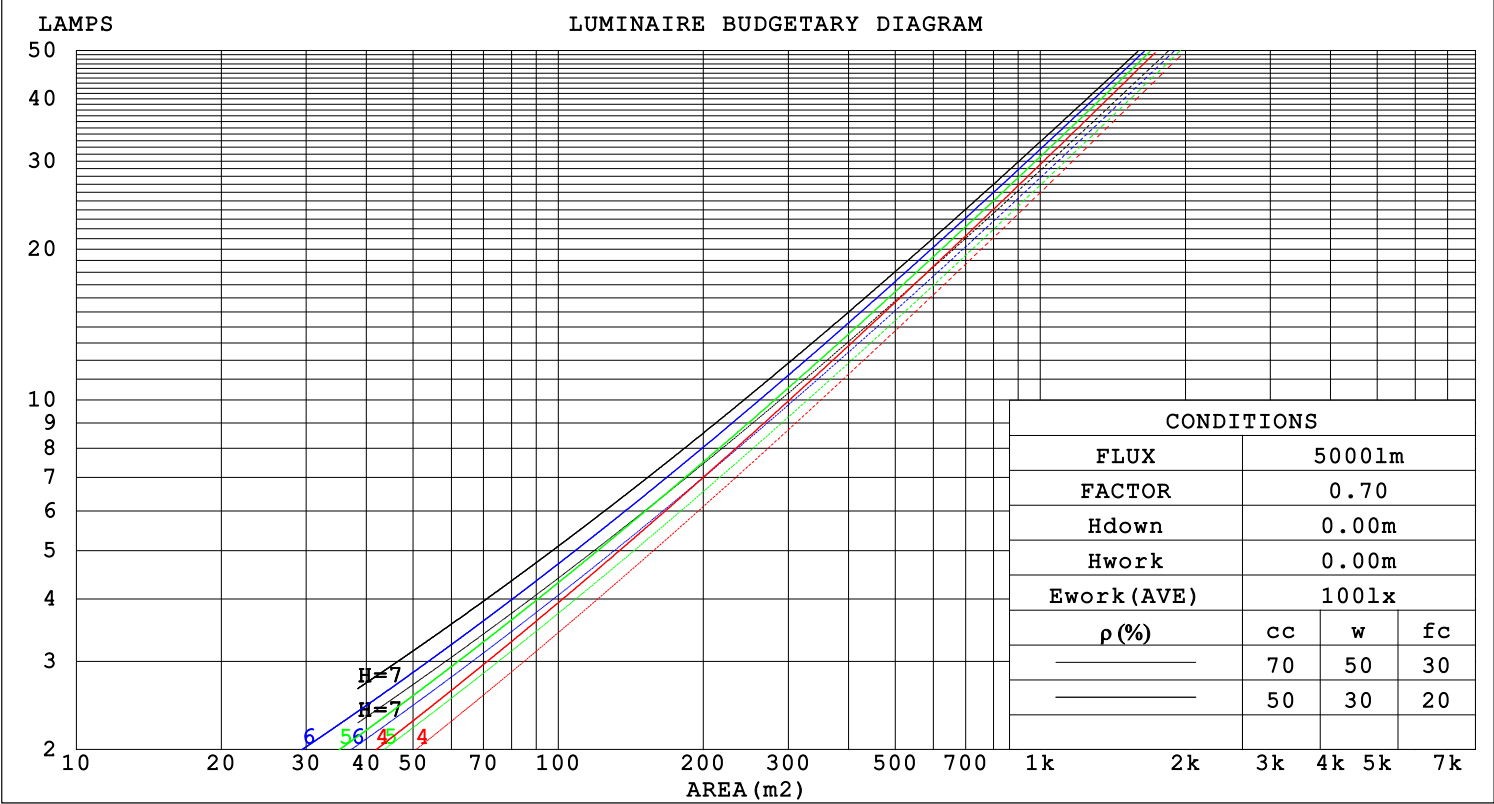

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

WEC AND CCEC

Report number:

MANUFACTURER: DIVINITY															
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019															
NAME: XTREME DUO PEGGY ANTIGLARE								TYPE: 3000K CRI-90				WEIGHT:			
SPECIFICATION: FULHAM-800 MA								DIMENSION: 1200*190*27 MM				SERIAL No.:			

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.217	.124	.039	.211	.120	.038	.198	.113	.036	.186	.107	.034	.175	.102	.033	
2.0	.209	.115	.035	.203	.112	.035	.192	.107	.033	.182	.102	.032	.173	.098	.031	
3.0	.198	.106	.032	.193	.104	.031	.184	.100	.030	.175	.096	.029	.167	.092	.029	
4.0	.187	.097	.029	.183	.096	.028	.175	.093	.028	.167	.090	.027	.160	.087	.026	
5.0	.177	.090	.026	.173	.089	.026	.166	.086	.025	.159	.084	.025	.153	.082	.024	
6.0	.167	.084	.024	.164	.083	.024	.157	.081	.023	.151	.079	.023	.146	.077	.023	
7.0	.158	.078	.022	.155	.077	.022	.149	.076	.022	.144	.074	.021	.139	.072	.021	
8.0	.150	.073	.021	.147	.072	.020	.142	.071	.020	.137	.070	.020	.133	.068	.020	
9.0	.142	.069	.019	.140	.068	.019	.135	.067	.019	.131	.066	.019	.127	.064	.019	
10.0	.136	.065	.018	.133	.064	.018	.129	.063	.018	.125	.062	.018	.122	.061	.018	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.174	.157	.142	.149	.135	.122	.102	.093	.084	.059	.054	.049	.019	.017	.016	
2.0	.161	.132	.108	.138	.114	.093	.095	.079	.065	.055	.046	.038	.018	.015	.012	
3.0	.151	.114	.084	.129	.098	.073	.089	.068	.051	.051	.040	.030	.016	.013	.010	
4.0	.142	.100	.068	.122	.086	.059	.084	.060	.041	.048	.035	.024	.016	.011	.008	
5.0	.134	.088	.055	.115	.077	.048	.079	.053	.034	.046	.031	.020	.015	.010	.007	
6.0	.126	.080	.046	.109	.069	.040	.075	.048	.028	.044	.028	.017	.014	.009	.006	
7.0	.120	.072	.039	.103	.063	.034	.071	.044	.024	.041	.026	.014	.013	.008	.005	
8.0	.114	.066	.033	.098	.057	.029	.068	.040	.021	.040	.024	.012	.013	.008	.004	
9.0	.109	.061	.029	.094	.053	.025	.065	.037	.018	.038	.022	.011	.012	.007	.004	
10.0	.104	.057	.025	.090	.049	.022	.062	.035	.016	.036	.021	.009	.012	.007	.003	

Test System:HOPOO HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:9.000 m
 Remarks: 3000K

Uncorrected UGR Table

Report number:

MANUFACTURER: DIVINITY											
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019											
NAME: XTREME DUO PEGGY ANTIGLARE					TYPE: 3000K CRI-90			WEIGHT:			
SPECIFICATION: FULHAM-800 MA					DIMENSION: 1200*190*27 MM			SERIAL No.:			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H	y = 2H	16.9	18.1	17.2	18.2	18.4	16.2	17.4	16.5	17.6	17.7
	3H	17.3	18.3	17.5	18.5	18.8	16.5	17.6	16.8	17.8	18.0
	4H	17.3	18.3	17.6	18.6	18.8	16.5	17.5	16.8	17.7	18.0
	6H	17.3	18.3	17.6	18.5	18.8	16.5	17.4	16.8	17.7	17.9
	8H	17.3	18.2	17.6	18.5	18.8	16.4	17.3	16.8	17.6	17.9
	12H	17.3	18.2	17.6	18.5	18.7	16.4	17.3	16.7	17.6	17.8
4H	2H	17.0	18.0	17.3	18.3	18.5	16.4	17.4	16.7	17.7	17.9
	3H	17.5	18.3	17.8	18.6	18.9	16.8	17.7	17.1	18.0	18.2
	4H	17.6	18.3	17.9	18.6	19.0	16.9	17.7	17.2	18.0	18.3
	6H	17.6	18.3	18.0	18.6	19.0	16.9	17.6	17.3	17.9	18.3
	8H	17.6	18.2	18.0	18.6	19.0	16.8	17.5	17.2	17.8	18.2
	12H	17.6	18.2	18.0	18.6	18.9	16.8	17.4	17.2	17.8	18.2
8H	4H	17.5	18.1	17.9	18.5	18.9	16.8	17.5	17.2	17.8	18.2
	6H	17.5	18.1	18.0	18.5	18.9	16.9	17.4	17.3	17.8	18.2
	8H	17.6	18.0	18.0	18.4	18.9	16.9	17.3	17.3	17.8	18.2
	12H	17.6	18.0	18.1	18.4	18.9	16.9	17.3	17.4	17.7	18.2
12H	4H	17.5	18.0	17.9	18.4	18.8	16.8	17.4	17.2	17.8	18.2
	6H	17.5	18.0	18.0	18.4	18.8	16.8	17.3	17.3	17.7	18.2
	8H	17.5	17.9	18.0	18.4	18.8	16.9	17.3	17.3	17.7	18.2
Variations with the observer position at spacings:											
S = 1.0H		+ 0.6 / - 0.6					+ 0.5 / - 0.7				
1.5H		+ 0.7 / - 0.8					+ 0.3 / - 0.6				
2.0H		+ 1.2 / - 1.8					+ 1.3 / - 1.5				

CIE Pub.117 Corrected 3791 lm Total Lamp Luminous Flux.(8log(F/F0) = 4.6)

Test System:HOPOO HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:9.000 m
 Remarks: 3000K

UTILIZATION FACTORS TABLE

Report number:

MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi, 301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	75	67	62	75	67	62	74	66	62	57
0.80	84	76	71	83	76	71	82	75	71	66
1.00	91	83	78	90	83	78	88	83	77	72
1.25	96	89	84	95	88	84	93	87	83	78
1.50	100	93	89	98	92	88	96	91	87	81
2.00	104	98	94	102	97	93	100	95	92	86
2.50	106	101	97	105	100	96	101	98	95	88
3.00	109	104	100	107	103	99	103	100	97	90
4.00	111	108	105	109	106	103	105	103	100	93
5.00	113	110	107	111	108	106	107	104	102	94
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		


Test System: HOPOO HPG1800
 Temperature: 25.3 DEG
 Operators:
 Test Date: 03-26-2025

Test Set: 5.0 deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 9.000 m
 Remarks: 3000K

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:

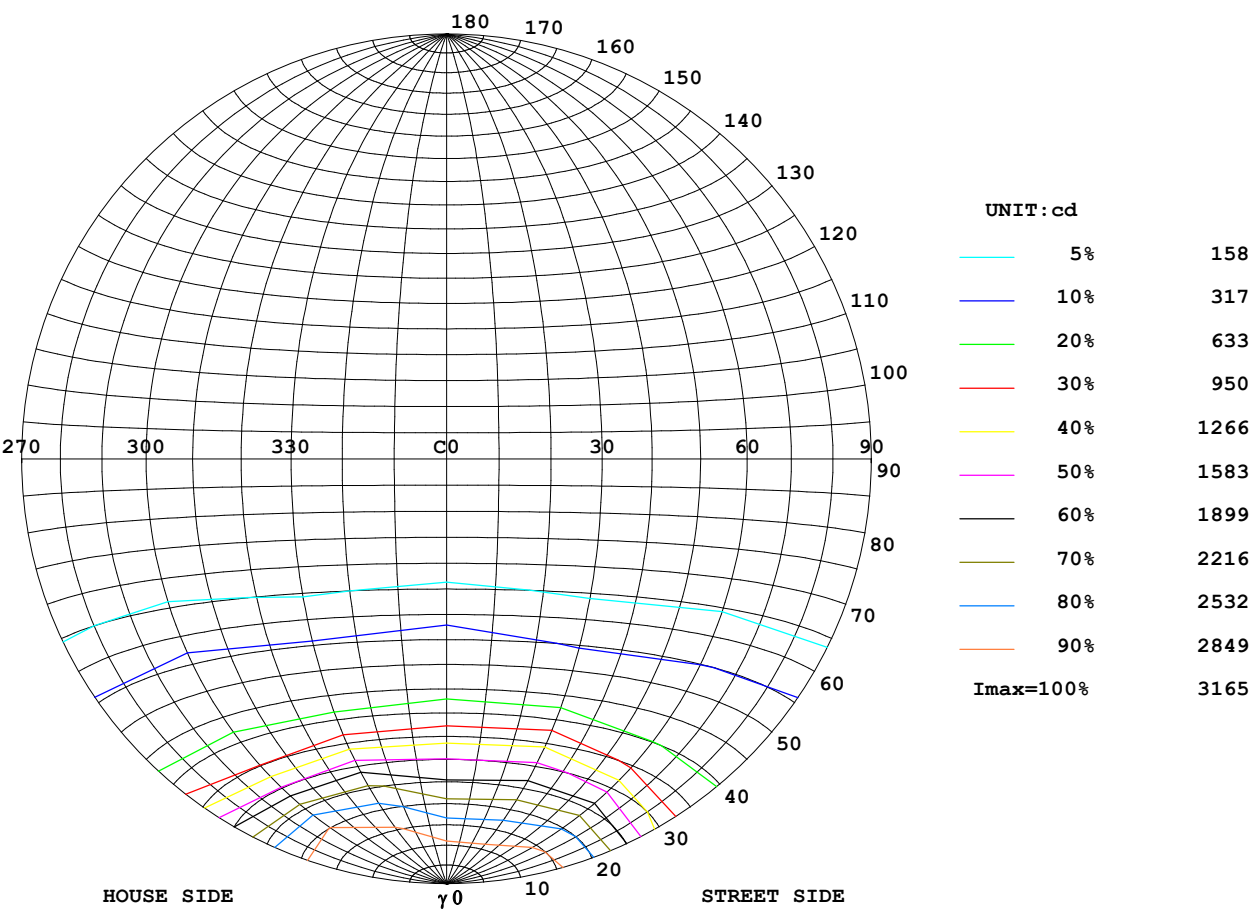

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

ISOLUX DIAGRAM

Report number:

MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:

ILLUMINANCE AT MH=10 m,Enadir = 31.59 lx




Test System:HOP00 HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:

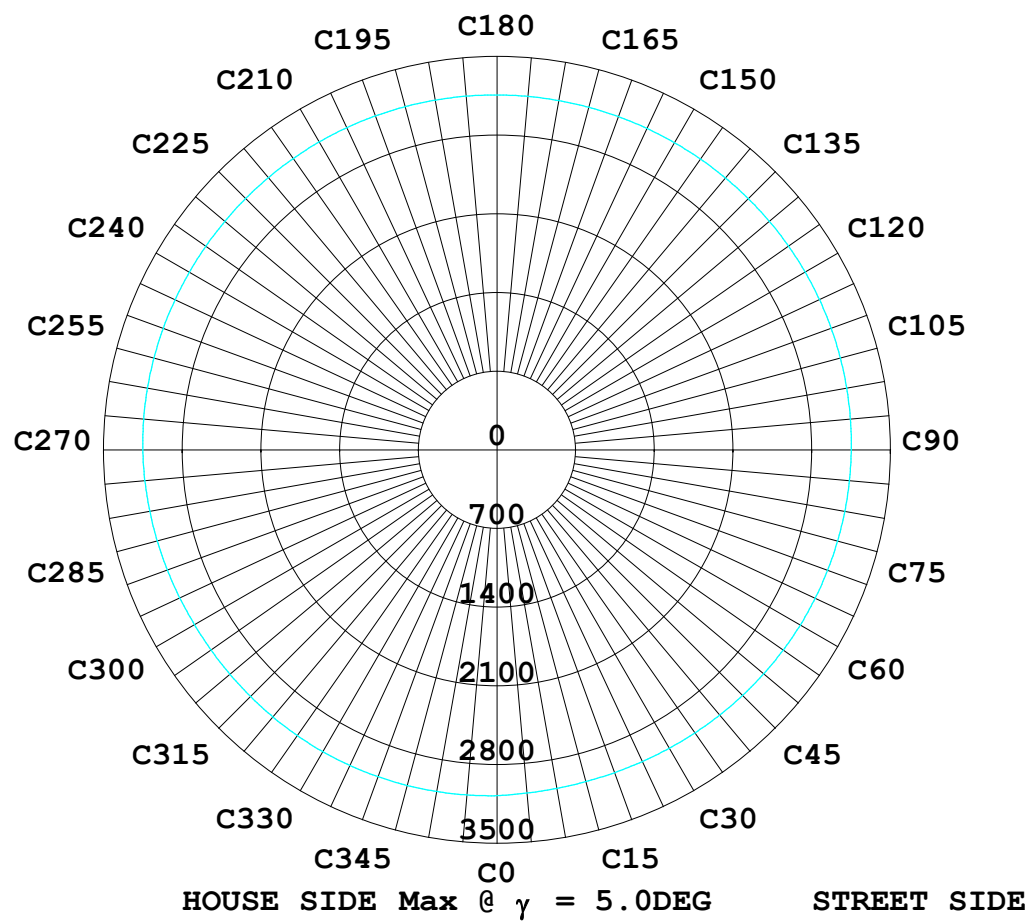

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K

LUMINOUS DISTRIBUTION INTENSITY DATA

Report number:

MANUFACTURER: DIVINITY		
Address: Plot No-A-89, RIICO Industrial Area, Karoli, Bhiwadi,301019		
NAME: XTREME DUO PEGGY ANTIGLARE	TYPE: 3000K CRI-90	WEIGHT:
SPECIFICATION: FULHAM-800 MA	DIMENSION: 1200*190*27 MM	SERIAL No.:

UNIT: cd

C (DEG) γ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330
0.0	3159	3159	3160	3159	3162	3163	3159	3159	3160	3159	3162	3163
5.0	3076	3064	3115	3151	3165	3157	3158	3164	3161	3152	3109	3100
10.0	2903	2909	3014	3068	3112	3056	3049	3094	3106	3121	3022	2971
15.0	2641	2675	2822	2912	2966	2873	2858	2935	3015	3045	2880	2712
20.0	2295	2376	2513	2571	2661	2598	2548	2667	2812	2850	2642	2454
25.0	1925	2031	2063	1919	2165	2267	2200	2364	2448	2385	2283	2125
30.0	1594	1656	1471	1167	1541	1874	1864	2024	1898	1603	1754	1787
35.0	1133	1192	894	760	950	1369	1380	1590	1228	955	1103	1379
40.0	726	751	635	619	650	856	862	1054	746	683	685	891
45.0	564	515	514	511	526	547	588	654	537	558	520	578
50.0	463	402	410	410	418	408	461	460	420	455	413	443
55.0	369	305	314	335	320	307	363	353	335	362	334	347
60.0	279	220	226	222	230	219	264	250	229	250	226	251
65.0	179	143	148	135	150	140	170	172	150	175	148	171
70.0	99.9	78.4	83.8	71.3	84.8	76.8	89.9	100	82.3	97.9	80.7	101
75.0	55.0	40.2	47.3	34.9	47.6	38.9	45.6	54.0	41.9	51.8	41.2	53.8
80.0	28.7	19.5	26.1	16.3	26.0	18.5	20.0	27.9	18.6	26.1	18.2	28.0
85.0	16.2	9.96	15.4	8.66	14.9	8.99	8.10	13.4	6.39	12.7	6.15	13.3
90.0	12.8	9.47	13.1	8.18	11.8	8.01	6.88	7.61	3.32	7.29	3.15	7.45

Test System:HOPOO HPG1800
Temperature:25.3DEG
Operators:
Test Date:03-26-2025

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:9.000 m
Remarks: 3000K